Specifications/Instructions



# ACTIVAL<sup>™</sup> Motorized Two-Way Valve with Flanged-End Connection <4-20 mA DC Input with 4-20 mA DC Feedback Output> (PN16 / GG-20) (Spring Return Type Actuator)

#### ■ Overview

ACTIVAL<sup>™</sup> Models VY5198H and VY5198K are series of motorized two-way valves with flanged-end connection. Valve and actuator are integrated in a single unit.

Valve size ranges from DN15 (1/2") to DN80 (3"), and valve body rating corresponds to ISO PN16.

Actuator has a reversible synchronous motor, which operates at a low voltage of 24 V AC. Since the actuator fully closes the valve in case of power failure, it is suitable for failsafe application.

4-20 mA DC input control signal provides proportional control in combination with a PLC (e.g., Model R35/R36).

\* PLC: Programmable Logic Controller



#### Features

- Compact and lightweight: Rotary motor actualizes small body and light weight.
- Valve and actuator integrated in a single unit: Pre-assembled body requires no adjustment.
- Valve for chilled/hot water control and for steam control applicable to high differential pressure, large Cv value, high rangeability, and low leakage.
- Durable actuator with low power consumption.
- Equal percentage flow characteristics.
- 4-20 mA DC output available for position feedback.
- Open/close changeover for input signal failure: Actuator fully opens/closes valve in case that the control signal is not input to the actuator. (Default: Fully open)

• Direction changeover of control action: Open/close action by 4-20 mA DC input signal is reversely controllable.

Normal action 4 mA: 0 % to 20 mA: 100 % Reverse action 20 mA: 0 % to 4 mA: 100 %. (Default: Normal action)

- Adjustable dead band\*: Dead band width can be narrowed to more precisely operate valve actuator.
- \* Actuator is not operated by input signal changed less than a certain amount. This amount of change is called dead band.
- Spring return actuator: Actuator automatically closes the valve in 0 % position in case that the power is down.

\* Although our company name changed from Yamatake Corporation to Azbil Corporation on April 1, 2012, our former logo remains on this product.

## Safety Precautions

Please read instructions carefully and use the product as specified in this manual.

Be sure to keep this manual near by for ready reference.

#### **Restrictions on Use**

This product was developed, designed, and manufactured for general air conditioning use.

Do not use the product in a situation where human life may be at risk or for nuclear applications in radiation controlled areas. If you wish to use the product in a radiation controlled area, please contact Azbil Corporation.

Particularly when the product is used in the following applications where safety is required, implementation of fail-safe design, redundant design, regular maintenance, etc., should be considered in order to use the product safely and reliably.

- Safety devices for protecting the human body
- Start/stop control devices for transportation machines
- Aeronautical/aerospace machines

For system design, application design, instructions for use, or product applications, please contact Azbil Corporation.

Azbil Corporation bears no responsibility for any result, or lack of result, deriving from the customer's use of the product.

#### Warnings and Cautions

	•						
٨	VARNING	Alerts users that improper handling may cause death or serious injury.					
	AUTION	Alerts users that improper handling may cause minor injury or material loss.					
■ Sign:	∎Signs						
	Alerts users possible hazardous conditions caused by erroneous operation or erroneous use. The symbol inside △ indicates the specific type of danger. (For example, the sign on the left warns of the risk of electric shock.)						
$\odot$	to prevent graphically	ers that specific actions are prohibited possible danger. The symbol inside / indicates the prohibited action. ple, the sign on the left notifies that					

disassembly is prohibited.) Instructs users to carry out a specific obligatory action to prevent possible danger. The symbol inside ● graphically indicates the actual action to be carried out. (For example, the sign on the left indicates general instructions.)

	M WARNING
0	When handling or transporting any heavy product (more than 18 kg), carefully move the product with a hand truck or the like, or with 2 or more people.
	Careless lifting or accidental dropping of the product may result in injury or product damage.
•	Before removing the actuator, fully close the valve.
U	If you try to remove the actuator without fully closing the valve, the actuator may suddenly rotate and cause an injury.
	Do not disassemble the spring unit. The spring may fly out of the unit and cause an injury.
	↑ CAUTION (1/3)
	Provide a circuit protector (e.g., a fuse or circuit
0	breaker) for the power source. Failure to do so may cause a short circuit leading to fire or device failure.
$\bigcirc$	Do not freeze this product. Doing so may damage the valve body and cause leakage.
0	When piping this product, be sure there is no foreign matter in the pipes. If foreign matter remains in the pipes, the product may break down.
0	Install, wire, and use this product under the conditions specified by this manual. Failure to do so may cause fire or device failure.
0	Use full face gaskets for flat face flanges. Failure to do so may damage the flanges or cause leakage outside of the valve.
0	When installing this product, hold it in the proper position and securely fasten it to the pipes. Excessive tightening or improper installation position may damage the valve.
0	After installation, make sure no fluid leaks from the valve-pipe connections. Improper piping may cause fluid leakage outside of the valve.
$\bigcirc$	Do not put a load or weight on this product. Doing so may damage the product.
	Installation and wiring of the actuator must be performed by personnel qualified to do instrumentation and electrical work. Mistakes in installation or wiring may cause fire or electric shock.
0	Before wiring, setting, maintenance, or replacement, be sure to turn off the power to this product. Failure to do so may result in electric shock or device failure.

	▲ CAUTION (2/3)
0	All wiring must comply with applicable codes and ordinances. Otherwise there is a danger of fire.
0	Use crimp terminals with insulation for connections to the product terminals. Failure to do so may cause short circuit leading to fire or device failure.
0	Tighten the terminal screws with the specified torque. Insufficient tightening of the terminal screws may cause fire or overheating.
0	After wiring, setting, engineering, maintenance, or replacement work, be sure to reattach the cover. Failure to do so may result in electric shock.

	▲ CAUTION (	3/3)
8	Do not touch any parts unless instructed to do in this manual. Failure to observe these precautions may re in burns, because actuator parts reach a h temperature.	esult
8	Do not carelessly touch this product when used to control hot water. Doing so may result in burns, because product reaches a high temperature.	

## IMPORTANT:

- The service life of ACTIVAL operated with small dead band can be shortened since the ACTIVAL operates more frequently with small dead band than with normal dead band.
- Use shielded cable for the ACTIVAL with small dead band. Noise may affect the signal transmission causing
  operation error, otherwise.
- To control ACTIVAL with a third-party controller, please consult with Azbil Corporations' sales personnel.

#### Model Numbers

Model VY519XK00XX/VY519XH00XX is the model for the valve and actuator integrated into a single unit.

The model number label is attached to the yoke. The 4-20 mA control signal is indicated on the actuator label and on the wiring diagram.

Base	Actuato	or/valve	Actu	lator	Valve	
model number	Control signal	Rating/ material	Туре		Nominal size/Cv	Description
VY51					1	Motorized two-way valve with flanged-end connection
	9					4 mA DC to 20 mA DC input with 4 mA DC to 20 mA DC feedback output
		8				PN16 / GG-20
			К			IEC IP54 protected and standard torque type spring return actuator with terminal block (Mountable valve sizes: DN15 to DN80)
			Н			IEC IP54 protected and standard torque type spring return actuator with terminal block for high differential pressure application (Mountable valve sizes: DN65 to DN80)
				00		—
					11	DN15 (1/2") / 1.0 in Cv value
					12	DN15 (1/2") / 2.5 in Cv value
					13	DN15 (1/2") / 6.0 in Cv value
					14	DN15 (1/2") / 1.6 in Cv value
					15	DN15 (1/2") / 4.0 in Cv value
					21	DN25 (1") / 10 in Cv value
					22	DN25 (1") / 16 in Cv value
					41	DN40 (1 <sup>1</sup> / <sub>2</sub> ") / 25 in Cv value
					42	DN40 (1 <sup>1</sup> / <sub>2</sub> ") / 40 in Cv value
					51	DN50 (2") / 65 in Cv value
					61	DN65 (2 <sup>1</sup> / <sub>2</sub> ") / 95 in Cv value
					81	DN80 (3") / 125 in Cv value

# ■ Specifications

For weight, refer to the table shown in the section **Dimensions.** 

## • Valve specifications

Item		Spe	ecification				
Model	Two-way valve with f	langed-end connectio	n (raised fac	e flange), pro	portional control		
Body pressure rating	PN16 (Max. working	pressure:1.6 MPa)			·		
End connection	Flanged-end, PN16	equivalent to ISO 700	5-2: 1988)				
Size, Cv, Close-off ratings				Close-off ratings			
Note: Close-off ratings of the actuator in combination	Model number	Nominal size	Cv	Steam	Chilled/hot water High-temperature water		
are shown on the right.	VY5198K0011	DN15 (1/2")	1.0	1.0 MPa	1.0 MPa		
Practical close-off rating required for the valve	VY5198K0012	DN15 (1/2")	2.5	1.0 MPa	1.0 MPa		
controlling 175 °C steam is 0.8 MPa.	VY5198K0013	DN15 (1/2")	6.0	1.0 MPa	1.0 MPa		
	VY5198K0014	DN15 (1/2")	1.6	1.0 MPa	1.0 MPa		
	VY5198K0015	DN15 (1/2")	4.0	1.0 MPa	1.0 MPa		
	VY5198K0021	DN25 (1")	10	1.0 MPa	1.0 MPa		
	VY5198K0022	DN25 (1")	16	1.0 MPa	1.0 MPa		
	VY5198K0041	DN40 (1 <sup>1</sup> / <sub>2</sub> ")	25	1.0 MPa	1.0 MPa		
	VY5198K0042	DN40 (1 <sup>1</sup> / <sub>2</sub> ")	40	1.0 MPa	1.0 MPa		
	VY5198K0051	DN50 (2")	65	1.0 MPa	1.0 MPa		
	VY5198K0061	DN65 (2 <sup>1</sup> / <sub>2</sub> ")	95	0.3 MPa	—		
	VY5198K0081	DN80 (3")	125	0.1 MPa	_		
	VY5198H0061	DN65 (2 <sup>1</sup> / <sub>2</sub> ")	95	1.0 MPa	0.7 MPa		
	VY5198H0081	DN80 (3")	125	0.7 MPa	0.4 MPa		
Materials	Body	Gray cast iron (GG-2	20)				
	Plug, stem	Stainless steel					
	Seat ring	Heat-resistant PTFE					
	Gland packing	Inorganic fiber					
	Gasket	Non-asbestos joint s	heet				
Applicable fluid	Chilled/hot water, hig	h-temperature water,	steam				
Allowable fluid temperature	0 °C to 175 °C (Non-	freezing)					
Flow characteristic	Equal percentage						
Rangeability	100 : 1						
Seat leakage	0.01 % of rated Cv v	alue (0.0006 Cv or les	s for DN15 r	model)			
Paint	Gray						
Actuator to be combined	Integrated with the v	alve					

# • Actuator specifications

Item		Specification					
Actuator type	Spring return actuator for s	standard and high differential pressure application					
Power supply	24 V AC ± 15 %, 50 Hz/60	Hz					
Power consumption	16 VA						
Timing	63 ± 5 sec (50 Hz) / 53 ± 5	63 ± 5 sec (50 Hz) / 53 ± 5 sec (60 Hz)					
	Return time: 3 to 40 secon	ds (Fully open $\rightarrow$ fully close operation)					
Control signal input	4 mA DC to 20 mA DC inp	ut (Input impedance: 100 Ω)					
Feedback signal output	Range: 4 mA DC (0 % pos	ition) to 20 mA DC (100 % position)					
	Max. load resistance: 500	Ω					
Materials	Case	Cast aluminum alloy					
	Top cover, terminal cover	Polycarbonate resin (Color: gray)					
	Yoke	Steel plate					
	Case of the spring unit	Cast aluminum alloy					
	Cover of the spring unit	Cast aluminum alloy					
	Spring	Stainless steel					
Surface finishing	Case	None					
	Yoke	Electro-galvanizing (Bright chromate finish)					
Valve position indication	Pointer located at the botto	om of the actuator shows the position by pointing at the value of					
	the scale (0: close to 100:	the scale (0: close to 100: open) on front, rear, and bottom sides.					
Manual operation	Not available.	Not available.					
Wires connection	M3.5 screw terminal conne	M3.5 screw terminal connection					
Enclosure rating	IEC IP54 (dust-proof and s	plash-proof)					
Insulation resistance	Between terminal and case	e: 5 MΩ or higher at 500 V DC					
Dielectric strength	Between terminal and case	e: 500 V AC/min with 1 mA or less leakage current					
Service life of spring return operation	30,000 operations						

## • Valve and actuator (as a single unit) specifications

Item	S	pecification					
Environmental conditions	Rated operating condition	Limit operating condition	Transport/storage conditions (packaged* <sup>2</sup> )				
Ambient temperature* <sup>1</sup>	-20 °C to 50 °C (Fluid temperature 0 °C to 150 °C) -20 °C to 40 °C (Fluid temperature 150 °C to 175 °C)	-20 °C to 60 °C	-20 °C to 70 °C				
Ambient humidity	5 %RH to 95 %RH						
Vibration	4.9 m/s <sup>2</sup> (10 Hz to 150 Hz)	19.6 m/s <sup>2</sup> (10 Hz to 150 Hz)					
	Notes: *1 Do not allow the fluid to freeze	e.					
	*2 Actuator shall be packed durir	ng transport and storage.					
	Ambient temperature (°C) $-20 \xrightarrow{50}{40}$ $-20 \xrightarrow{-20}{5} \xrightarrow{100}{100}$ 150 175 Fluid temperature (°C)						
Installation locations	Indoor / outdoor (Keep away from direct sunlight.) Note: Salt air, corrosive gas, flammable gas, and organic solvent must be avoided.						
Mounting position	Installable in any position ranging from upright to sideways (90° tilted.) * Always install in upright position outdoors.						
Factory preset position	0 % (fully closed) preset at factory.						

## • Options


For options, separate order is required.


Item	Specification
Seal connector	Applicable wire size:
(Part No. 83104346-003)	(Seal connector is necessary for IEC IP54 protection.)
Auxiliary switches*1	Number of auxiliary switches: 2 (SW A and SW B)
(Part No. 83174063-101)	Maximum applied voltage/current: 30 V DC / 100 mA*2 DC (Inductive load includes inrush current.)
	Actuating position
	SW A: Adjustable between 0 % (fully closed) to 100 % (fully open)
	SW B: Adjustable between 0 % (fully closed) to 100 % (fully open)
Auxiliary potentiometer*1	Number of auxiliary potentiometer: 1
(Part No. 83165275-001)	Overall resistance: Nominal 1 k $\Omega$
	Operating position: 0 % (fully closed) to 100 % (fully open)
	Max. applied voltage: 5 V DC

Note:

\*1 Either the auxiliary switch or auxiliary potentiometer can be added, but not both. \*2 If the applied current exceeds 100 mA, please contact Azbil Corporation.

## Dimensions

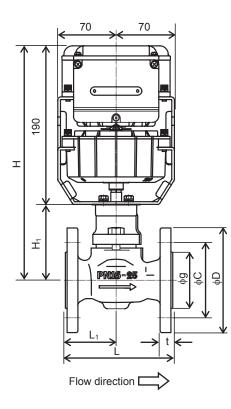

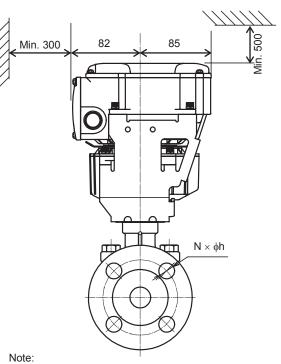

Leave a clearance of 100 mm if you do not open the top cover (to set the selector switches after the ACTIVAL is installed).

## Model VY5198K00XX

Model number	Valve size (DN)	H (mm)	H₁ (mm)	L (mm)	L <sub>1</sub> (mm)	t (mm)	φC (mm)	φD (mm)	φg (mm)	φh (mm)	Ν	Weight (kg)
VY5198K001X	15	265	75	108	50	16	65	95	46	14	4	6.6
VY5198K002X	25	280	90	127	60	18	85	115	65	14	4	8.6
VY5198K004X	40	293	103	165	82.5	20	110	150	84	19	4	12.0
VY5198K0051	50	297	107	178	89	20	125	165	99	19	4	13.5
VY5198K0061	65	314	124	190	90	22	145	185	118	19	4	18.0
VY5198K0081	80	315	125	203	100	22	160	200	132	19	8	20.5

## Model VY5198H00X1

Model number	Valve size (DN)	H (mm)	H <sub>1</sub> (mm)	L (mm)	L <sub>1</sub> (mm)	t (mm)	φC (mm)	φD (mm)	φg (mm)	φh (mm)	Ν	Weight (kg)
VY5198H0061	65	314	124	190	90	22	145	185	118	19	4	18.5
VY5198H0081	80	315	125	203	100	22	160	200	132	19	8	20.5

Figure 1. Dimensions and maintenance clearance (mm): Models VY5198K00XX, VY5198H00X1

## ■ Parts Indication

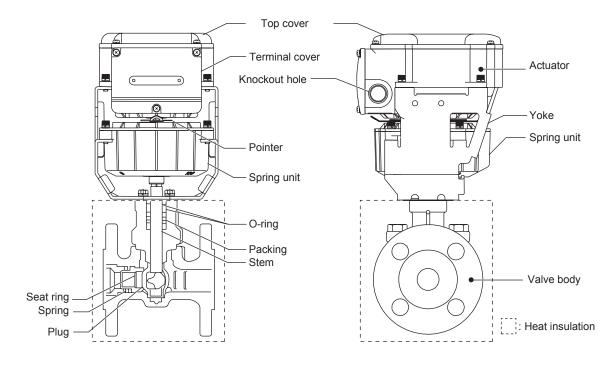


Figure 2. Parts indication

## Setting

On the PCB (printed circuit board) of the actuator, the selector switches are provided.

	A CAUTION
0	Before beginning setup work, be sure to turn off the power to this product. Failure to do so may result in electric shock or device failure.
0	After setup work, be sure to reattach the cover. Failure to do so may result in electric shock.
8	Do not touch any parts unless instructed to do so in this manual. Failure to observe these precautions may result in burns, because actuator parts reach a high temperature.

## IMPORTANT:

- Set the selector switches using a pen nib or a finger. Do not use a tool such as a screwdriver. Such a tool can damage the selector switches or the PCB.
- The service life of ACTIVAL operated with small dead band can be shortened since the ACTIVAL operates more frequently with small dead band than with normal dead band.
- To operate the product with small dead band, provide shielded cable for input/output signal lines and power line. Unshielded cable can cause error due to noise.

#### • Identification of the selector switches

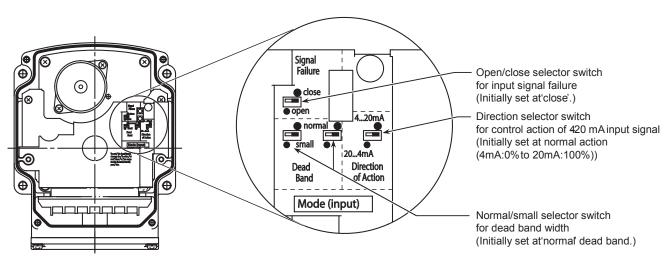


Figure 3. Selector switches

Open/close selector switch for input signal failure:

If no control signal is input, the actuator automatically closes (0 %) or opens (100 %) the valve by setting the selector switch at 'open' (100 %) or 'close' (0 %).

Direction selector switch for control action of 4-20 mA input signal:

Direction of control action by 4-20 mA DC input signal can be reversely switched.

Normal action: 4 mA for 0 % to 20 mA for 100 % Reverse action: 20 mA for 0 % to 4 mA for 100 %

Normal/small selector switch for dead band width:

To more precisely operate the valve, smaller dead band (than the normal) of the control signal input can be set. Two selector switches are provided for the normal/small dead band width. Always set the both switches at the same mode ('normal' or 'small').

#### Installation

## MARNING

When handling or transporting any heavy product (more than 18 kg), carefully move the product with a hand truck or the like, or with 2 or more people.

Careless lifting or accidental dropping of the product may result in injury or product damage.

Before removing the actuator, fully close the valve.

If you try to remove the actuator without fully closing the valve, the actuator may suddenly rotate and cause an injury.

# ▲ CAUTION

$\bigcirc$	Do not freeze this product. Doing so may damage the valve body and cause leakage.
0	When piping this product, be sure there is no foreign matter in the pipes. If foreign matter remains in the pipes, the product may break down.
0	Install, wire, and use this product under the conditions specified by this manual. Failure to do so may cause fire or device failure.
0	Use full face gaskets for flat face flanges. Failure to do so may damage the flanges or cause leakage outside of the valve.
0	Installation and wiring of the actuator must be performed by personnel qualified to do instrumentation and electrical work. Mistakes in installation or wiring may cause fire or electric shock.

#### • Precautions for installation

- ACTIVAL Model VY5198K/VY5198H is the valve and actuator integrated into a single unit. Do not combine the valve with any other actuator, or do not combine the actuator with any other valve.
- To remove foreign substances inside the pipes, install a strainer (with 40 or more meshes) on the inflow side of each valve. In case that the strainers cannot be installed on the inflow side of each valve, install it on the pipe diverting sections (sections diverting from main piping system to sub piping system).
- Install the valve so that the flow direction of process fluid agrees with the arrow indicated on the valve body.

#### Installation location

#### IMPORTANT:

- The top and the terminal covers might be corroded by chemicals and organic solvent or their vapor. Do not
  expose the ACTIVAL to such substances/vapor.
- When the ACTIVAL is used for steam humidifying, install a valve interlocking with air-conditioning unit on the inflow side in case the ACTIVAL gets damaged.
- Although the ACTIVAL can be used in high humidity environments (max. 95 %RH), do not immerse the actuator in water.
- Although the ACTIVAL can also be used outdoors, be sure not to expose the ACTIVAL to direct sunlight.
- Install the ACTIVAL in a position allowing easy access for maintenance and inspection. Fig. 1 shows the minimum clearance for maintenance and inspection. When installing the ACTIVAL in a ceiling space, provide an access hole within the 50 cm radius of the ACTIVAL. And, place a drain pan under the valve.
- Do not install the product nearby a steam coil or a hot-water (in high temperature) coil. High heat radiation may result in an actuator malfunction.
- Do not mount the ACTIVAL on a pipe where water hammer occurs, or where solid objects including slug may accumulate.
- To set the selector switches after installation, leave a enough clearance above the top cover of the actuator, as shown in Fig. 1.

#### Mounting position

The ACTIVAL can be mounted in any position ranging from upright to sideways (90° tilted). The ACTIVAL should be installed with its actuator vertically positioned above the valve body. (See Fig. 4.) However, the ACTIVAL must be installed always in upright position outdoors.




Figure 4. Actuator mounting position

#### • Piping

## ▲ CAUTION

When installing this product, hold it in the proper position and securely fasten it to the pipes. Excessive tightening or improper installation position may damage the valve.

- Check that the model number of the product is what you ordered. The model number is shown on the label attached to the yoke.
- Install a bypass pipe and gate valves on the inflow, outflow, and bypass sides. Also, install a strainer with 40 or more meshes (with 80 or more meshes recommended for steam control) on the inflow side.
- When installing the ACTIVAL to the pipes, do not allow any object, such as chips, to get inside a pipe or valve. Valve cannot fully closes, or the valve seat may get damaged causing fluid leakage, due to an object jammed inside the valve.
- When piping, do not apply too much sealing material, such as solidifying liquid and tape, to the pipe connection sections so that these materials flow into the valve. Valve cannot fully closes, or the valve seat may get damaged causing fluid leakage, due to the sealing material jammed inside the valve.
- Before activating the ACTIVAL, fully open (in 100 % position) the valve and flush the pipes (with the ACTIVAL installed) at the maximum flow rate to remove all the foreign substances. (Factory preset position: 0 %)
- For steam control, drain retained water (condensate) in piping. Install a trap on a pipe run which may retain condensate. Condensate may cause water hummer or damage the valve and piping.

▲ CAUTION			
0	After installation, make sure no fluid leaks from the valve-pipe connections. Improper piping may cause fluid leakage outside of the valve.		
$\bigcirc$	Do not put a load or weight on this product. Doing so may damage the product.		

#### Heat insulation

Do not apply heat insulation to the actuator or to the yoke, as shows in Fig. 2. If the yoke and the actuator are covered with insulation material, the pointer cannot be checked and may be distorted.

#### • Factory preset position

The actuator shaft is positioned at 0% (in fully open position) for shipment. The shaft is thus completely turned counterclockwise, and the pointer points at '0'. (See Fig. 5.)




Figure 5. Pointer position for shipment

#### • Auxiliary switch / Auxiliary potentiometer (optional)

#### IMPORTANT:

- The auxiliary switch/potentiometer is installed on site. Refer to the instructions supplied with the auxiliary switch/potentiometer for installation.
- Do not open the top cover except when adjusting the auxiliary switch/potentiometer. Close the top cover instantly after adjusting the auxiliary switch/potentiometer.
- Do not put any load on the top cover.

#### ■ Wiring

▲ CAUTION			
0	Provide a circuit protector (e.g., a fuse or circuit breaker) for the power source. Failure to do so may cause a short circuit leading to fire or device failure.		
0	Install, wire, and use this product under the conditions specified by this manual. Failure to do so may cause fire or device failure.		
0	Installation and wiring of the actuator must be performed by personnel qualified to do instrumentation and electrical work. Mistakes in installation or wiring may cause fire or electric shock.		
0	Before wiring, be sure to turn off the power to this product. Failure to do so may result in electric shock or device failure.		
0	All wiring must comply with applicable codes and ordinances. Otherwise there is a danger of fire.		
0	Use crimp terminals with insulation for connections to the product terminals. Failure to do so may cause short circuit leading to fire or device failure.		
0	Tighten the terminal screws with the specified torque. Insufficient tightening of the terminal screws may cause fire or overheating.		
0	After wiring, be sure to reattach the cover. Failure to do so may result in electric shock.		

## IMPORTANT:

- The ACTIVAL is designed for 24 V AC power supply voltage. Do not apply any other power voltage (e.g., 100 V AC, 200 V AC) to the ACTIVAL.
- Make sure the polarity of the power supply and 4-20 mA DC feedback output referring to the wiring diagrams. Incorrect wiring may result in PCB (print circuit board) burnout.
- To prevent damage, cover the terminals except when connecting/disconnecting wires.
- Do not connect 24 V AC power to the terminals 4 to 7.

#### Wiring procedure

1)To lead the wires into the terminals, cut out a knockout hole for a wiring port. Two knockout holes are provided on the bilateral sides of the actuator terminals. Select a knockout hole according to the conduit mounting direction, and cut it out by lightly knocking the hole using a screwdriver.


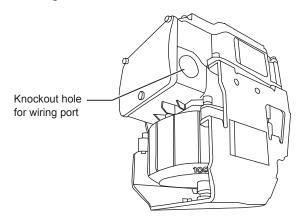



Figure 6. Knockout hole for wiring port

#### **IMPORTANT:**

 Do not leave any refuse including metal chips after cutting a knockout hole and after connecting the wires inside the actuator.

2)Unscrew the 3 setscrews (M4  $\times$  10) of the terminal cover and remove the terminal cover, as shown in Fig. 7.



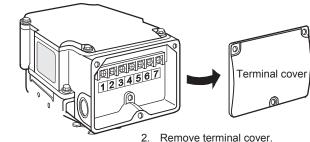

1. Unscrew the setscrews

Figure 7. Terminal cover removal

3)Correctly connect the wires to the terminals with M3.5 screw terminal lugs, referring to Figs 8 to 10.

4)When the ACTIVAL is used in a high-humidity environment or outdoors, use a water-proof connector for the wiring port.


#### To keep IP54 protection (dust-proof and splash-proof),

Use a water-proof connector for the ACTIVAL in a high-humidity environment or outdoor location.

• Be sure to completely close the terminal cover and the top cover.

- Waterproof the wiring port.
  - For cable connection, use a water-proof connector. (Seal connector Part No. 83104346-003 is recommended.)
  - For conduit connection, use a water-proof plica tube or the like.

#### • Terminals connection

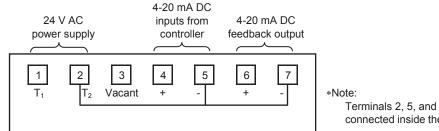


Terminals 2, 5, and 7 are connected inside the actuator.

Figure 8. Terminals connection of Model VY519XK/VY510XH

## Connection Examples (Connection to Azbil Corporations' R series controller)

Connection to Model R35TC0/R36TC0

Connection to Model R35TC0/R36TC0 (Parallel operation)

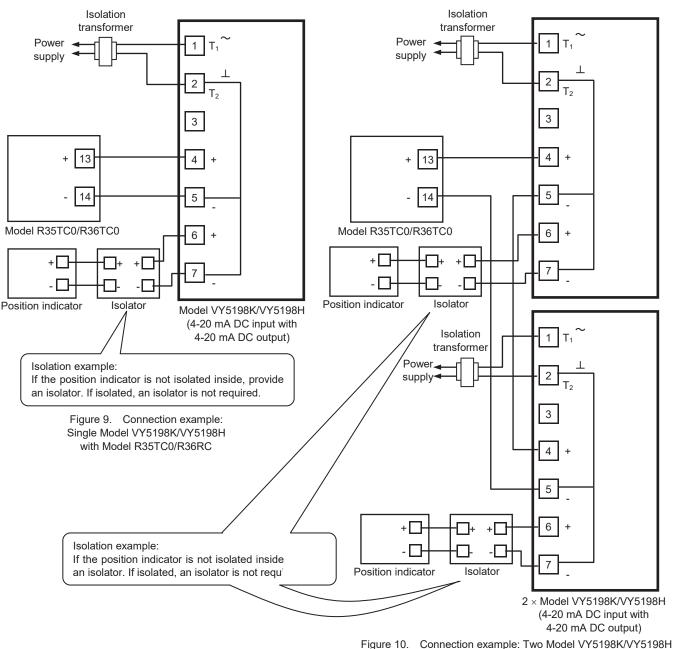


with Model R35TC0/R36RC (Parallel operation)

Notes:

- \* Input impedance of the actuator is 100  $\Omega$ .
- \* For connecting multiple ACTIVAL to one controller (e.g., Model R35.36), provide a transformer (two in total) for each ACTIVAL since 4-20 mA input is not isolated from other terminals.
- \* Terminals 2, 5, and 7 are connected inside the actuator. To connect to a device (PLC, position indicator, etc.) with its terminals not isolated inside, externally isolate (between the ACTIVAL and the device). Otherwise, a loop is formed for the common line and can damage the circuit of the ACTIVAL. (R series controllers including Model R35/R36 shown in Figs. 9 and 10 are isolated inside.)
- \* Isolation transformer is required for ACTIVAL. Transformer without isolation may damage the ACTIVAL and other devices connected to ACTIVAL.


## Internal Connection of Auxiliary Switch / Auxiliary Potentiometer

• Auxiliary switch Part No. 83174063-101

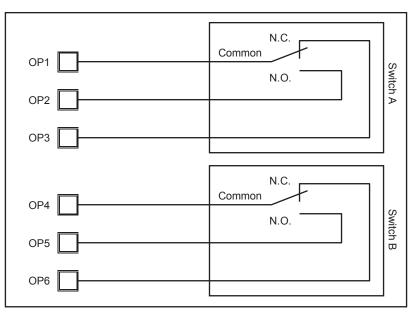

Switches A and B actuating position: Adjustable between 0 % (fully closed) and 100 % (fully open) Figure 11. Internal connection of Part No. 83174063-101

#### • Auxiliary potentiometer Part No. 83165275-001

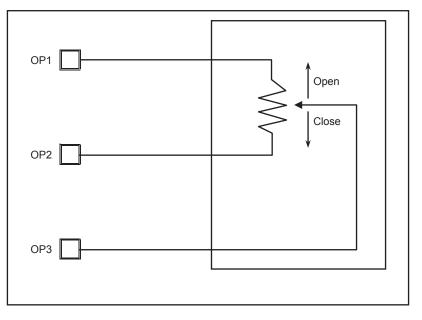

Potentiometer operating position: Between 0 % (fully closed) and 100 % (fully open) Figure 12. Internal connection of Part No. 83165275-001

#### ■ Maintenance

▲ WARNING				
0	Before removing the actuator, fully close the valve. If you try to remove the actuator without fully closing the valve, the actuator may suddenly rotate and cause an injury.			
	Do not disassemble the spring unit. The spring may fly out of the unit and cause an injury.			
▲ CAUTION				
$\bigcirc$	Do not put a load or weight on this product. Doing so may damage the product.			
0	Before doing maintenance, be sure to turn off the power to this product. Failure to do so may result in electric shock or device failure.			
0	After maintenance, be sure to reattach the cover. Failure to do so may result in electric shock.			
	Do not carelessly touch this product when it is used to control hot water. Doing so may result in burns, because the product reaches a high temperature.			

- Inspect the ACTIVAL according to Table 1.
- Manually open/close the ACTIVAL at least once a month if it is left in inactive state for a long period.
- Visually inspect the fluid leakage of the valve and the actuator operations every six months. If any of the problems described in Table 2 are found, take corresponding actions shown in the table. If your problem is not solved by the corresponding action, please contact Azbil Corporation near you.

Inspection item	Inspection interval	Inspection detail	
Visual inspection	Semiannual	<ul> <li>Fluid leakage from the gland and the flange face</li> <li>Loosened bolts</li> <li>Valve and actuator damages</li> </ul>	
Operating status	Semiannual	<ul><li>Unstable open/close operation</li><li>Abnormal noise and vibration</li></ul>	
Routine inspection	Any time	<ul> <li>Fluid leakage to the outside</li> <li>Abnormal noise and vibration</li> <li>Unstable open/close operation</li> <li>Valve hunting</li> </ul>	

#### Table 1. Inspection items and details

Table 2. Troubleshooting					
Problem	Part to check	Action			
Fluid leaks from the flange face.	Loosened flange bolts Gasket on the flange face Misaligned piping	Tighten the flange bolts. Replace the gasket. Redo piping.			
Fluid leaks from the gland part.		Consult with our sales personnel.			
Fluid leaks from the bonnet.	Loosened bolts	Tighten the bolts.			
Valve does not operate smoothly / valve stops halfway / valve does not operate at all.	Conditions of the power applied and of the input signal applied Loosened terminals Wiring condition / disconnected wires	Check the power supply and the controller connected to. Tighten the terminals. Check the wiring.			
Fluid leaks to the outside of the valve when the ACTIVAL is in fully closed position.	Actuator pointer not pointing to fully closed position	Fully close the ACTIVAL.			
The valve vibrates or produces an abnormal noise.	Primary pressure condition Differential pressure condition	Adjust the mounting position and change the installation location.			
The auxiliary switch does not operate.	Auxiliary switch (cam switch) condition Loosened terminals Wiring condition / disconnected wires	Redo the cam switch setting. Tighten the terminals. Check the wiring.			
The auxiliary potentiometer does not operate.	Condition of resistance Loosened terminals Wiring condition / disconnected wires	Check the resistance value (1 kΩ). Tighten the terminals. Check the wiring.			
Valve hunting occurs.	Secondary pressure condition Differential pressure condition Control stability	Adjust the mounting position and change the installation location. Correct the control parameter setting of controller.			
Operating time of the spring return is too short.	Wiring condition of the brake motor	Consult with our sales/service personnel.			
Operating time of the spring return is too long. The spring return does not operate.	Torque of valve operation	Consult with our sales/service personnel.			
The actuator does not fully closes the valve (in 0 % position).	-	Consult with our sales/service personnel.			
Input signal disagrees with the feedback output signal.	To completely shut off the valve, valve open and close (0-100% position) operation is controlled by 10-90 % range of actuator voltage/current input signal. Input signal therefore disagrees with the feedback signal, and this is not an error.				

## Disposal

Dispose of this product as industrial waste in accordance with your local regulations. Do not reuse all or any part of the product.



This product complies with the following harmonised standards of the Electromagnetic Compatibility Directive (EMCD). EMCD: EN61000-6-2 EN55011 Class A, Group 1

ACTIVAL and Infilex are trademarks of Azbil Corporation in Japan or in other countries.

# **Azbil Corporation**

**Building Systems Company** 

1-12-2 Kawana, Fujisawa, Kanagawa 251-8522 JAPAN https://www.azbil.com/



AB-7366 Rev. 3.0 Jun. 2021