

Advanced Controller for Pump Units

Overview

This product (Model WJ-1102P) is a controller that controls the central plant facilities for buildings.

It uses I/Os that have been built for the central plant instrumentation along with control application programs to provide optimal control.

It can also handle cases where monitoring points, control applications, etc. are added during operation.

It is compatible with various open protocols such as BACnet/IP, BACnet MS/TP, Modbus™ RTU, Modbus ASCII.

With an optional Ooperator Interface (model QJ-1101D0000), operational status of heat source equipment can be checked. Also, using the Operator Interface allows standalone operation without the central monitoring unit.



Features

Open communication protocol

This product is compatible with BACnet/IP which is an open protocol.

RS-485 communication allows connection of various devices that support BACnet MS/TP, Modbus RTU, or Modbus ASCII.

Connecting various I/Os

It provides various I/Os such as DI (digital input), DO (digital output), UI (universal input), and AO (analog output).

The UI is compatible with the input types of current, voltage, resistance (Pt100, Pt1000), and DI.

Since Advanced Remote I/O Module (Model RJ-11) can be attached to the network by ETHERNET, it is possible to install the Advanced Remote I/O Module close to the facility equipment that is away from this product to save the labor for construction.

Visualized I/O statuses

This product uses LEDs for DI, DO, and UI to indicate the status of the feedback input from facility equipment and the ON/OFF output to facility equipment.

• Optimal operation for the central plant system Depending on the air conditioning load, the product controls the number of operating pumps. If a pump breaks down, the product automatically starts the substitute pumps as necessary. It also supports operation during power failure and power recovery, and even when a power failure occurs, operation can be resumed automatically when power is recovered.

Various applications for the secondary pump variable flow control are available, so energy conservation is possible.

• Online engineering work

If a need to change or add the monitoring points or control applications arises during operation, it is possible to change the controller files without stopping the controller.

- Connection to the building management system By connecting to the central monitoring unit of the building management system, it is possible to centrally manage each facility from the central monitoring unit.
- Risk distribution

If there is something abnormal occurred in the building management system, the Advanced Controller for Pump Units independently executes the backup operations.

Thus, the risk can be distributed in case of failure.

Safety Precautions —

Please read instructions carefully and use the product as specified in this manual.

Be sure to keep this manual nearby for quick reference.

Restrictions on Use

This product was developed, designed, and manufactured for general air conditioning use.

Do not use the product in a situation where human life may be at risk or for nuclear applications in radiation controlled areas. If you wish to use the product in a radiation controlled area, please contact Azbil Corporation.

Particularly when the product is used in the following applications where safety is required, implementation of fail-safe design, redundant design, regular maintenance, etc., should be considered in order to use the product safely and reliably.

- Safety devices for protecting the human body
- Start/stop control devices for transportation machines
- Aeronautical/aerospace machines

For system design, application design, instructions for use, or product applications, please contact Azbil Corporation.

Azbil Corporation bears no responsibility for any result, or lack of result, deriving from the customer's use of the product.

Caution for Instrumentation Design

Considering unexpected failures or contingencies, be sure to design and check safety of the system and equipment.

Recommended Design Life

It is recommended that this product be used within the recommended design life.

The recommended design life is the period during which you can use the product safely and reliably based on the design specifications.

If the product is used beyond this period, its failure ratio may increase due to time-related deterioration of parts, etc.

The recommended design life during which the product can operate reliably with the lowest failure ratio and least deterioration over time is estimated scientifically based on acceleration tests, endurance tests, etc., taking into consideration the operating environment, conditions, and frequency of use as basic parameters.

The recommended design life of this product is 11 years.

Caution for Transporting

Lithium batteries are used in this product.

When this product, which uses lithium batteries, is transported by air or sea, ship it in accordance with IATA-DGR/IMDG-Code regulations.

Please inform your shipping company that lithium batteries are included in the product, and follow the necessary procedures according to the company's instructions.

If the product is shipped by air or sea without the necessary labels, etc., specified by the ordinances, you may be in violation of aviation or maritime safety laws and be subject to punishment.

Warnings and Cautions



Alerts users that improper handling may cause death or serious injury.

Alerts users that improper handling may cause minor injury or material loss.

Signs



Alerts users to possible hazardous conditions caused by erroneous operation or erroneous use. The symbol inside \triangle indicates the specific type of danger. (For example, the sign on the left warns of the risk of electric shock.)



Notifies users that specific actions are prohibited to prevent possible danger. The symbol inside \bigcirc graphically indicates the prohibited action. (For example, the sign on the left means that disassembly is prohibited.)



Instructs users to carry out a specific obligatory action to prevent possible danger. The symbol inside ● graphically indicates the actual action to be carried out. (For example, the sign on the left indicates general instructions.)

▲ WARNING

Install this product in a place, such as a control cabinet, where only the administrator has access to it.

Electric shock Otherwise there is a danger of electric shock.

General

General

Prohibition

▲ CAUTION

Take anti-lightning surge measures based on regional and building characteristics. Lightning may cause fire or critical damage to this product if protective measures are not taken.

Install, wire, and use this product under the conditions specified by this manual. Failure to do so may cause fire or device failure.

Do not use an uninterruptible power supply (UPS) that outputs rectangular waves. Doing so may cause the device to fail.

System Configuration

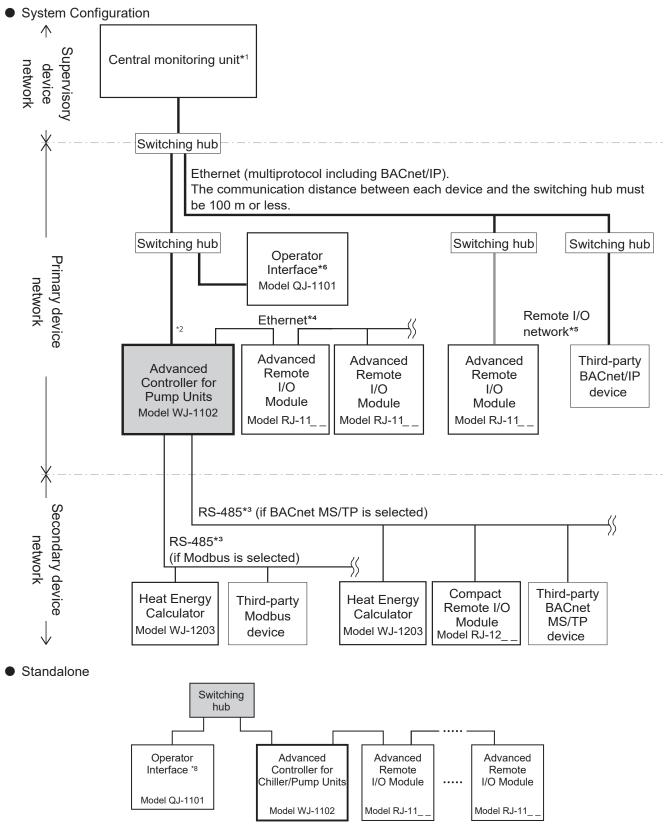


Figure 1. Example system configuration

- *1 Azbil's Supervisory Controller (model BH-101G0W0000) or a third-party central monitoring unit using BACnet/IP communications can be used for central monitoring.
- *2 The Advanced Controller for Pump Units uses BACnet/IPv4 or BACnet/IPv6. The IPv6 specification is based on BACnet-2012 (compliant with the IEIEJ-G-0006:2017 standard by the Institute of Electrical Installation Engineers of Japan) with ANNEX U of BACnet-2016.
- *3 The Advanced Controller for Pump Units has two RS-485 communication channels.
 - For each channel, a communication protocol can be selected from among BACnet MS/TP, Modbus™ RTU, and Modbus ASCII.
 - Number of connectable devices if BACnet MS/TP is used
 - If only Azbil devices are connected:
 - 50 devices per channel (Compact Remote I/O Modules, Heat Energy Calculator, etc.)
 - If only third-party devices are connected:
 - 31 devices per channel (with a transmission speed of 76.8 kbps, 30 objects per device)
 - Number of connectable devices if Modbus is used
 - 31 devices per channel (with a transmission speed of 76.8 kbps, 30 objects per device)

If the third-party devices have different transmission speeds or number of objects, or if Azbil devices and third-party devices are on the same channel, the number of devices that can be connected will vary. For details, please contact Azbil Corporation.

- *4 A network that connects the Advanced Controller for Pump Units and Advanced Remote I/O Modules under its control is referred to as the local I/O network. A switching hub is not required for the local I/O network since daisy-chain Ethernet is used between the Controller and the Advanced Remote I/O Modules under its control, as well as between the Advanced Remote I/O Modules.
- *5 A network that connects the Advanced Controller for Pump Units and Advanced Remote I/O Modules through a host network is referred to as the remote I/O network. A switching hub is required to connect the Advanced Remote I/O Modules to the remote I/O network. The maximum number of Advanced Remote I/O Modules connected to this network is three per Advanced Controller for Pump Units. When IPv6 for BACnet communication is used, Advanced Remote I/O Modules cannot be connected via the remote I/O network.
- *6 The Operator Interface (model number QJ-1101D000) can manage a maximum of four controllers (model number WJ-1102_ or WJ1103W000).

Model Numbers

WJ-1102P123456 / WJ-1102P123456-U*1

Ir	<u>1</u> nstrumentation type	n Number of pumps												<u>4</u> Pressure control		<u>5</u> Language		<u>6</u> Power ecification
1	Fixed	2	2	3	1 system flow (with energy monitoring)	0	None	1	English	W	100–240 V AC							
		4	4	4	4 systems flow (with energy monitoring, 4 systems totalization)	1	Proportional bypass valve(current/voltage)	2	Chinese (Simplified)									
		8	8			3	N inverters + proportional bypass valve (current/voltage)	3	Chinese (Traditional)									
						5	All inverters + ON/OFF bypass valve	4	Korean*1									

*1 The model number WJ-1102Q____4_-U cannot be selected because the UL-certified models do not have Korean language support.

• Optional parts

Model number	Description
83104567-001	DIN rail clamp
83172137-001	RS-485 terminators (x 10), 120 Ω
83173763-001	4–20 mA 250 Ω resistors (x 8)

• Replacement parts

Model number	Description	Remarks		
83173707-001	Power connector (x 1)			
83173708-001	RS-485 connectors (connector for RS-485-1 × 1, connector for RS-485-2 × 1)			
83170639-001	3170639-001 Lithium battery (x 1)			
83170639-005	Lithium batteries (x 5)			
83170639-010	Lithium batteries (x 10)			

Specifications

Basic specifications

Power supply Input voltage 100–240 V AC (or 100–264 V AC) Power frequency 50/60 Hz ± 3 Hz Power consumption 30 VA max. Inrush current 20 A max. (for 100 V AC) Leakage current 0.2 mA max. (for 240 V AC) Leakage current 0.2 mA max. (for 240 V AC) Insulation resistance Between the power terminals and the ground 100 MΩ or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM. 32 MB Flash ROM. 2 MB 5 RAM, RTC backup Power of channels Communications RS-485 Number of channels 2 Protocol BACnet MS/TP: Modbus ^M / TO, Modbus ^M / Communication speed idistance BACnet MS/TP: Number of connect- able devices BACnet MS/TP: Only the third-party devices are connected: up to Only the third-party protocol Communication	
Power consumption 30 VA max. Inrush current 20 A max. (for 100 V AC) 40 A max. (for 100 V AC) 40 A max. (for 100 V AC) Leakage current 0.2 mA max. (for 240 V AC) Insulation resistance Between the power terminals and the ground 100 MΩ or more (500 V DC) 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Protocol BACnet MS/TP; Modbus™ RTU, Modbus™ ATU, Modbus ASCII: 4.8 kbps, 9.6 k Speed Number of connect- able devices 1000 m max. distance Number of connect- Number of connect- able devices are connected: up to Communication 1000 ms, 1000 Mps, 100 Mbps There are restrictions depending on the soft FTHERNET Communication type (LAN 1, LAN 2) Communication type Protocol Protocol Power POM resin <	
Inrush current 20 A max. (for 100 V AC) 40 A max. (for 240 V AC) Leakage current 0.2 mA max. (for 100 V AC) 0.5 mA max. (for 100 V AC) Insulation resistance Between the power terminals and the ground 100 M0 or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB5 RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels Protocol BACnet MS/TP; Modbus™ RTU, Modbus™ A Communication speed Insulation resistance BACnet MS/TP; Modbus MTU, Modbus M Communication Number of connect- able devices BACnet MS/TP; Only the Azbil devices are connected: up to ONly the third-party devices are connected: up to ONly the third-party devices are connected: up to ONly the Azbil devices are connected: to channel ETHERNET (LAN 0) Communication type Autoregotilon, MDI/MDI-X auto recognition Protocol BACnet MS/TP; Only Mesint Communication type ETHERNET (LAN 1, LAN 2) Communication type MDI/MDI-X auto recognition Protocol BACnet MS/TP; Protocol <td></td>	
40 A max. (for 240 V AC) Leakage current 0.2 mA max. (for 240 V AC) 0.5 mA max. (for 240 V AC) 0.5 mA max. (for 240 V AC) Insulation resistance Between the power terminals and the ground 100 MO or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM. RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Communication speed Protocol BACnet MS/TP, Modbus™ RTU, Modbus™/ Communication speed 1000 m max. 38.4 kbps, 19.2 kbps, 3 Communication flo00 m max. distance 1000 m max. Number of connect- able devices able devices Only the Azbit devices are connected: up to Communication type <	
Leakage current 0.2 mA max. (for 100 V AC) 0.5 mA max. (for 240 V AC) Insulation resistance Memory device RAM, RTC backup Communications RS-485 Number of channels 2 Protocol BACnet MS/TP. Modbus™ RTU, Modbus™ ATU, Modbus ASCI: 4.8 kbps, 9.6 k Communication BACnet MS/TP: 0.100 m max. Communication distance 1000 m max. Number of connect- able devices Able devices Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Number of ports 2 ETHERNET Communication type (LAN 1, LAN 2) Communication type Protocol BACnet/IP (IPv4 or IPv6) Case, cover Modified PPE resin DIN holder POM resin Weight Case, cover Modified PPE resin DIN hold	
CPU 0.5 mA max. (for 240 V AC) Insulation resistance Between the power terminals and the ground 100 MQ or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Protocol Communications RS-485 Number of channels 2 Protocol BACnet MS/TP; Modbus™ RTU, Modbus™ J Communication speed BACnet MS/TP; Modbus ASCII: 4.8 kbps, 9.6 k Communication distance Number of connect- able devices BACnet MS/TP; Only the Abil devices are connected: up to Only the third-party devices are connected: up to Onmunication ETHERNET Communication type Autonegot	
CPU 0.5 mA max. (for 240 V AC) Insulation resistance Between the power terminals and the ground 100 MQ or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Protocol Communications RS-485 Number of channels 2 Protocol BACnet MS/TP; Modbus™ RTU, Modbus™ J Communication speed BACnet MS/TP; Modbus ASCII: 4.8 kbps, 9.6 k Communication distance Number of connect- able devices BACnet MS/TP; Only the Abil devices are connected: up to Only the third-party devices are connected: up to Onmunication ETHERNET Communication type Autonegot	
Insulation resistance Between the power terminals and the ground 100 MΩ or more (500 V DC) CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Protocol BACnet MS/TP, Modbus™ RTU, Modbus™ A Communication speed BACnet MS/TP: Modbus RTU, Modbus ASCI: 4.8 kbps, 0.6 k Communication 1000 m max. distance Number of connect- able devices Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: u to Only the Azbil devices are connected: u to Only the Azbil devices are connected: n channel Modbus RTU and Modbus ASCI: up to 31 pr There are restrictions depending on the soft ETHERNET (LAN 0) Communication type ETHERNET (LAN 1, LAN 2) Communication type Protocol BACnet/IP (IPv4 or IPv6) Communication type MDI/MDI-X auto recognition Protocol Protocol Communication type MDI/MDI-X auto recognition Protocol Protocol	
CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Protocol BACnet MS/TP, Modbus [™] ATU, Modbus ASCII: 4.8 kbps, 9.6 k Communication speed Number of connect- able devices BACnet MS/TP: Only the third-party devices are connected: up to Only the third-party devices are connected: up to Communication type ETHERNET (LAN 1, LAN 2) Communication type MDI/MDI-X auto recog	d terminal
CPU 32-bit Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Protocol BACnet MS/TP, Modbus™ RTU, Modbus™ f Communication BACnet MS/TP: speed Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k Communication 1000 m max. distance Number of connect- able devices Only the Azbil devices are connected: up to Number of connect- BACnet MS/TP: Only the third-party devices are connected: up to Only the Azbil devices are connected: up to Modbus RTU and Modbus ASCII: up to 31 p There are restrictions depending on the soft There are restrictions depending on the soft Communication type Mutore of ports 2 Communication 1000 Mbps, 100 Mbps speed Speed ETHERNET Communication type (LAN 0) Communication type ETHERNET Communication type (LAN 1, LAN 2) Communication type Major material Case, cover Modified PPE resin <td></td>	
Memory device 256 MB SDRAM, 32 MB Flash ROM, 2 MB S Powered by lithium batteries (not rechargeat Powered by lithium batteries (not rechargeat Protocol Communications RS-485 Number of channels Protocol 2 Communication speed BACnet MS/TP; Modbus™ RTU, Modbus™ BACnet MS/TP: 9.6 kbps, 19.2 kbps, 3 76.8 kbps, 9.6 k Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k Modbus RTU, Modbus ASCII: 4.8 kbps, 76.6 Communication distance 1000 m max. 38.4 kbps, 76.6 Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the third-party devices are connec	
RAM, RTC backup Powered by lithium batteries (not rechargeat Communications RS-485 Number of channels 2 Protocol BACnet MS/TP, Modbus™ RTU, Modbus™ Communication speed BACnet MS/TP: 9.6 kbps, 19.2 kbps, 5 Communication distance T6.8 kbps Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k 38.4 kbps, 76.8 Number of connect- able devices BACnet MS/TP: 0.6 kbps Number of connect- able devices BACnet MS/TP: 0.100 m max. ETHERNET (LAN 0) Communication type BACnet MS/TP: 0.01y the Azbil devices are connected: up to Only the third-party devices are connected: up to Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to 31 p There are restrictions depending on the soft ETHERNET (LAN 0) Communication type Protocol BACnet/IP (IPv4 or IPv6) Communication type MDI/MDI-X auto recognition Protocol Protocol Protocol Major material Case, cover Modified PPE resin DIN holder	SRAM
Communications RS-485 Number of channels 2 Protocol BACnet MS/TP, Modbus™ RTU, Modbus™ Q, kbps, 19.2 kbps, 5 76.8 kbps Communication BACnet MS/TP: 9.6 kbps, 19.2 kbps, 5 Speed 1000 m max. 38.4 kbps, 76.8 Number of connect- able devices 1000 m max. 38.4 kbps, 76.8 Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to 31 pr There are restrictions depending on the soft ETHERNET (LAN 0) Communication type Autonegotiation, MDI/MDI-X auto recognition Transport/ Number of ports 2 Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication type Molfied PPE resin Uh holder POM resin Weight 1.10 kg Environmental conditions Ambient 0-50 °C Ambient humidity 10–90 % RH (without condensation)	
Protocol BACnet MS/TP, Modbus™ ATU, Modbus™ / Communication speed BACnet MS/TP: 9.6 kbps, 19.2 kbps, 3 76.8 kbps Communication speed BACnet MS/TP: 000 m max. 9.6 kbps, 19.2 kbps, 3 76.8 kbps, 9.6 kbps, 19.2 kbps, 3 76.8 kbps, 9.6 kbps, 19.2 kbps,	510)
Employee Communication speed BACnet MS/TP: 9.6 kbps, 19.2 kbps, 5 76.8 kbps 76.8 kbps Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k 38.4 kbps, 76.8 Communication distance Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the third-party devices are connected: up to Only the third-party devices are connected: up to Only the Azbil devices are	
kip speed 76.8 kbps Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k 38.4 kbps, 76.8 Communication distance 1000 m max. Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the third-party devices a	
Modbus RTU, Modbus ASCII: 4.8 kbps, 9.6 k 38.4 kbps, 76.8 Communication distance 1000 m max. Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the third-party protocol ETHERNET (LAN 1, LAN 2) Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication type MDI/MDI-X auto recognition Major material Case, cover Modified PPE resin Weight I.10 kg Environmental conditions	50.4 корз,
Major material Rated operating conditions Communication distance 1000 m max. Vumber of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the Azbil devices are connected: up to Only the third-party devices are connected: up to Only the	uhna 10.0 luhnu
distance Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the third-party devices are connected: up to 31 pu There are restrictions depending on the soft Protocol ETHERNET (LAN 0) Communication type Autonegotiation, MDI/MDI-X auto recognition Protocol BACnet/IP (IPv4 or IPv6) Communication communication ETHERNET (LAN 1, LAN 2) Number of ports 2 Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication speed 100 Mbps Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Ambient temperature 0-50 °C temperature Ambient humidity 10-90 % RH (without condensation) Attitude 2000 m max. Vibration 5.9 m/s² max., 10-150 Hz	
Number of connect- able devices BACnet MS/TP: Only the Azbil devices are connected: up to Only the third-party devices are connected: up to Only the third-p	
kinesize able devices Only the Azbil devices are connected: up to Only the third-party devices are connected: up to Speed ETHERNET (LAN 1, LAN 2) Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication type Major material Case, cover Modified PPE resin Meight I.10 kg Environmental conditions Ambient conditions 0-50 °C temperature Ambient humidity 10-90 % RH (without condensation) Attitude 2000 m max. Vibration 5.9 m/s² max., 10-150 Hz	
Additional and the second state and the s	50 per chann
Additional and a construction of the sector of the sect	
Image: series of the series	up to 51 per
ETHERNET (LAN 0)Communication typeAutonegotiation, MDI/MDI-X auto recognition BACnet/IP (IPv4 or IPv6)ETHERNET (LAN 1, LAN 2)ProtocolBACnet/IP (IPv4 or IPv6)ETHERNET (LAN 1, LAN 2)Number of ports2Communication typeMDI/MDI-X auto recognitionProtocolProprietary protocolCommunication typeMDI/MDI-X auto recognitionProtocolProprietary protocolCommunication typeMOI/MDI-X auto recognitionProtocolProprietary protocolCommunication typeModified PPE resinDIN holderPOM resinWeight1.10 kgEnvironmental conditionsAmbient temperatureConditionsAmbient temperatureAmbient humidity10–90 % RH (without condensation)Altitude2000 m max.Transport/ storageAmbient temperatureTransport/ storageAmbient temperature	
ETHERNET (LAN 0)Communication typeAutonegotiation, MDI/MDI-X auto recognitionProtocolBACnet/IP (IPv4 or IPv6)Communication1000 Mbps, 100 MbpsSpeed1000 Mbps, 100 MbpsETHERNET (LAN 1, LAN 2)Number of ports2Case, coverModified PPE resinMajor materialCase, coverModified PPE resinMeight1.10 kgEnvironmental conditionsAmbient temperature0-50 °CConditionsAmbient temperature0-90 % RH (without condensation)Altitude torage2000 m max. vibration2000 m max.Vibration5.9 m/s² max., 10-150 HzTransport/ storageAmbient temperature-20-60 °C	
(LAN 0)ProtocolBACnet/IP (IPv4 or IPv6)Communication speed1000 Mbps, 100 MbpsETHERNET (LAN 1, LAN 2)Number of ports2Communication typeMDI/MDI-X auto recognitionProtocolProprietary protocolCommunication speed100 MbpsMajor materialCase, coverModified PPE resinWeightCase, coverModified PPE resinEnvironmental conditionsAmbient temperature0-50 °CEnvironmental conditionsAmbient temperature0-90 % RH (without condensation)Altitude Vibration2000 m max.Transport/ storageAmbient temperature-20-60 °C	
Karling Communication speed 1000 Mbps, 100 Mbps ETHERNET (LAN 1, LAN 2) Number of ports 2 Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication speed 100 Mbps Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Ambient 0-50 °C Conditions Ambient 0-50 °C Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ storage Ambient -20–60 °C	n
Image: speedSpeedETHERNET (LAN 1, LAN 2)Number of ports2Communication typeMDI/MDI-X auto recognitionProtocolProprietary protocolCommunication speed100 MbpsMajor materialCase, coverModified PPE resinWeightDIN holderPOM resinWeight1.10 kgEnvironmental conditionsAmbient temperature0-50 °CConditionsAmbient temperature0-50 °CTransport/ storageAmbient temperature0-90 % RH (without condensation)Attitude temperature2000 m max. -20-60 °C	
ETHERNET (LAN 1, LAN 2)Number of ports2Communication typeMDI/MDI-X auto recognitionProtocolProprietary protocolCommunication speed100 MbpsMajor materialCase, coverModified PPE resinDIN holderPOM resinWeight1.10 kgEnvironmental conditionsAmbient temperatureRated operating conditionsAmbient temperature0-50 °CAmbient humidity10-90 % RH (without condensation)Altitude2000 m max.Vibration5.9 m/s² max., 10-150 HzTransport/ storageAmbient temperature-20-60 °C	
(LAN 1, LAN 2) Communication type MDI/MDI-X auto recognition Protocol Proprietary protocol Communication speed 100 Mbps Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Ambient 0-50 °C conditions Ambient humidity 10-90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ Ambient -20-60 °C	
Protocol Proprietary protocol Communication speed 100 Mbps Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Ambient conditions 0–50 °C Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ storage Ambient temperature	
Major material Communication speed 100 Mbps Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Rated operating conditions Ambient temperature Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ storage Ambient temperature	
Image: material speed Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Rated operating conditions Ambient to merature Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ storage Ambient temperature	
Major material Case, cover Modified PPE resin DIN holder POM resin Weight 1.10 kg Environmental conditions Rated operating conditions Ambient to 0–50 °C Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ storage Ambient temperature	
DIN holder POM resin Weight 1.10 kg Environmental conditions Rated operating conditions Ambient temperature 0-50 °C Ambient humidity 10-90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10-150 Hz Transport/ storage Ambient -20-60 °C	
Weight 1.10 kg Environmental conditions Rated operating conditions Ambient demograture 0-50 °C Ambient humidity 10-90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10-150 Hz Transport/ storage Ambient demograture	
Environmental conditions Rated operating conditions Ambient defined and the second sec	
Environmental conditions Rated operating conditions Ambient defined and the second sec	
conditions temperature Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ Ambient -20–60 °C storage temperature	
Ambient humidity 10–90 % RH (without condensation) Altitude 2000 m max. Vibration 5.9 m/s² max., 10–150 Hz Transport/ Ambient -20–60 °C storage temperature	
Altitude2000 m max.Vibration5.9 m/s² max., 10–150 HzTransport/Ambientstoragetemperature	
Vibration5.9 m/s² max., 10–150 HzTransport/Ambient-20–60 °Cstoragetemperature	
Transport/ storageAmbient temperature-20-60 °C	
storage temperature	
conditions Ambient humidity 5–95 % RH (without condensation)	
Vibration (storage) 5.9 m/s ² max., 10–150 Hz	
Vibration (transport) 9.8 m/s ² max., 10–150 Hz	
Others • No corrosive gas should be detected.	
The product should not be exposed to direct	ct sunlight.
• Do not let the product get wet.	
Installation location In the control panel	
Mounting Mounted on a DIN rail or with screws	
CPU: central processing unit ROM: read-only memory	

MDI: medium dependent interface MDI-X: medium dependent interface crossover PPE: polyphenylene ether RAM: random-access memory

RTC: real-time clock SDRAM: synchronous dynamic random-access memory SRAM: static random-access memory

• Input/output specifications

	Item		Specification			
Digital input	Number of input	terminals	4			
	Voltage		24 V DC typ.			
	Current		5 mA DC typ.			
	Connected device	ce output type	Dry contact or open collector			
	Rated dry conta		Allowable ON contact resistance 100Ω max.Allowable OFF contact resistance $100 k\Omega$ min.Allowable ON residual voltage $2 V$ max.			
	Rated open colle	ector voltage/current				
		solor voltago/ourront	Allowable OFF leakage current $500 \ \mu A$ max.			
	Pulse integratior	`				
	Puise integration	1	10 Hz max. Note: Digital input pulse integration requires a pulse width and a pulse interval that satisfy the conditions shown in the following figure. 30 ms min. 100 ms min.			
Universal input	Number of input	terminals				
eorear input	Voltage input	Input range	0–10 V DC, 2–10 V DC, 0–5 V DC, 1–5 V DC			
	voltago inpat	Input impedance	1 MΩ typ.			
	Current input	Input range	4–20 mA			
	Ourient input	Input impedance	100 Ω typ.			
	Resistance	Connected sensor	Pt100, Pt1000			
			P1100, P11000			
	temperature	output type				
	detector input	Pt100 sensor	0–50 °C, 0–100 °C, 0–200 °C, -20–80 °C, -20–30 °C,			
		measurement range	-50–100 °C, -100–50 °C			
		Pt1000 sensor	0–50 °C, 0–100 °C, -20–80 °C, -20–30 °C, -50–100 °C			
		measurement range				
	Digital input	Voltage 5 V DC typ.				
		Current	1.5 mA DC typ. Dry contact or open collector			
		Connected device				
		output type				
		Rated dry contact	Allowable ON contact resistance 100 Ω max.			
		resistance	Allowable OFF contact resistance 100 k Ω min.			
		Rated open collector	Allowable ON residual voltage 2 V max.			
		voltage/current	Allowable OFF leakage current 100 µA max.			
Digital output	Relay output	Number of output	6			
5 1	(normally open	terminals				
	contact)	Output type	Relay output, normally open contact			
	contacty	Rated contact voltage/	24 V AC, 0.5 A max. (Max. inductive load: $\cos\phi = 0.4$)			
		current	24 V DC, 0.5 A max.			
		Min. applicable load	5 V DC, 10 mA			
Analog output	Number of outpu		6			
, maiog output	Voltage output	Output range	0–10 V DC, 2–10 V DC, 0–5 V DC, 1–5 V DC			
		Load resistance	10 kΩ min. (-10°) $(-10$			
	Current output	Output range	4–20 mA			
		Load resistance				
Controller	Number of outpu		500 Ω max. 1			
alarm output*	Relay output	Output type	Relay (photo MOS relay), normally open contact			
alarini odiput	. totay output		Normal: ON			
			Abnormal, power off, idling, debugging, initializing: OFF			
		Pated contact valtage/				
		Rated contact voltage/	24 V AC, 100 mA max.			
	A 11 11 11	current	24 V DC, 100 mA max.			
	Applicable volta		24 V AC ±15 %, 24 V DC ±15 %			
	Contact ON resi	stance	20 Ω max.			

* Overcurrent protection circuit is built-in.

When the overcurrent protection circuit works due to short-circuit, lightning surge, etc., the contact will break (the same state when an alarm occurs).


In order to recover the state to normal, turn off the power supplied to the output circuits and then turn on the power.

Specifications for Wiring

Item	Recommended wire	Specification	Max. wiring length	Connection type	Remarks
Power supply	IV, CVV, or equivalent	1.25–2.0 mm ² stranded wire (AWG16–AWG14)	—	Screw terminal block	
Ground	Ground IV, CVV, or equivalent		_	Screw terminal block	Ground the product with resistance less than 100 Ω .
ETHERNET (LAN 0)	-	EIA/TIA-568 category 5e or higher	100 m	RJ-45 moduler connector	
ETHERNET (LAN 1 / LAN 2)	_	EIA/TIA-568 category 5e or higher	100 m	RJ-45 moduler connector	
RS-485	Belden 3106A, 3107A, 9842, or equivalent	0.2–0.3 mm ² shielded twist- ed-pair cable (AWG24–AWG22)	1200 m	Screw terminal block	Use the cable that satisfies the following specifications: Impedance: $100-130 \Omega$ Capacities between conduc- tors: 100 pF/m max . Capacities between conductor and shield: 200 pF/m max .
Digital input	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	100 m	Screw terminal block	
Digital output	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	100 m	Screw terminal block	
Universal input (Voltage/current/ digital inputs)	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	100 m	Screw terminal block	
Universal input (input for RTD Pt100 or Pt1000))	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	100 m	Screw terminal block	Since the wiring resistance will cause an error, wires with a cross-sectional area of 1.25 mm ² (AWG 16) are recommended.
Analog output (Voltage/current outputs)	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	100 m	Screw terminal block	
Controller alarm output	IV, CVV, or equivalent	0.5–1.25 mm ² stranded wire (AWG20–AWG16)	30 m	Screw terminal block	

AS-1002E

Dimensions





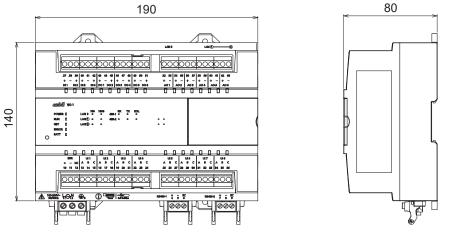


Figure 2. Dimensions (mm)

Parts Indication

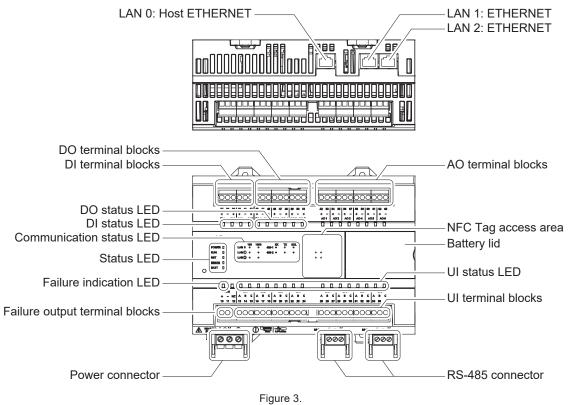

Instrumentation

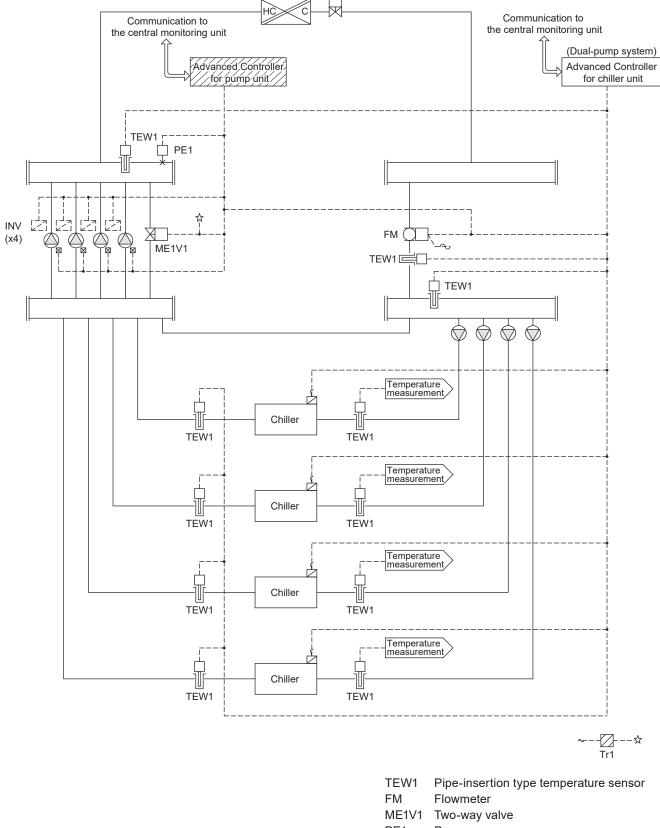

PE1 Pressure sensor

Figure 4. Example close-loop dual-pump system instrumentation

INV Inverter

Control Function

- Operation management
 - (1) Auto/Manual changeover

Change over between Auto and Manual with the I/O object for auto/manual changeover (BV) or DI input.

Manual DI input has the highest priority.

- Note: Wait for at least 10 seconds after manual changeover before starting or stopping units after changing over from Auto to Manual.
- Manual

The operating status before changing the mode is maintained. Sequence control is not executed. When Manual is selected, you can start or stop the unit manually.

Auto

When Group command is ON, sequence control is executed.

(2) Group command

Execute the command operation with the I/O object for group command (BO) or DI input.

- Note: When the system is operated with the group command from the central monitoring unit, the group command DI via anti-freeze control can also be used.
- Group command ON When Auto is selected, sequence control is executed.
- Group command OFF When Auto is selected, all the units are stopped.
- (3) Daytime/nighttime mode changeover Change over between modes with the I/O object for daytime/nighttime changeover (BV) or DI input.
 - Note: The operation sequence table, the maximum number of operating units, and the start load are changed over between the daytime mode and the nighttime mode.
- (4) Cooling/heating mode changeover Change over between the modes with the I/O object


for cooling/heating changeover (BV) or DI input.

Note: The operation sequence table, the maximum number of operating units, and the start load are changed over between the cooling mode and the heating mode.

- Units control
 - (1) Sequence control method


Flow rate is used as the load on sequence control and it is compared with the total rated capacity of operating chillers to define the appropriate number of operating chillers.

Models that support up to a 4-system flow rate are also available.



- (2) Operation sequence change method One of the following operation sequence change methods can be selected.
 - Sequential method

The start and stop sequence is fixed. Units with higher priority start earlier and stop later.

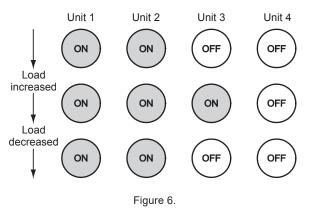

• Sequential method with base unit changeover This is one of the sequential methods.


When Group command is OFF, the operation sequence is shifted by 1 so that the unit with the highest priority moves to the lowest position.

Rotation method

This method controls the operating hours of each unit to be leveled.

There are two methods.

- (1) Starts or stops the unit according to its running hours. To increase the supply capacity, it starts the unit that has been stopped for the longest time. To decrease the supply capacity, it stops the unit that has been running for the longest time. The lowest starting order is assigned to the unit that has just started.
 - Note: This method is not intended to compare the runtime of units and sort the starting order by their runtime.
- (2) Starts or stops the unit according to its total runtime. In order to level the runtime of each unit exactly, it starts the unit whose total runtime is the shortest first, and stops the unit whose total runtime is the longest first.
 - Note: Since the total runtime is used for deciding which unit should start, if the value of a unit is preset to "0," that unit starts up first. Be aware of this when the total runtime is preset to "0."

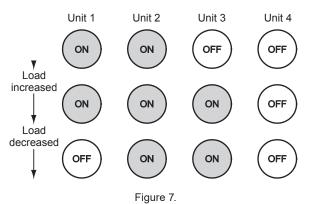

- Rotation method with forced increase capacity This is one of the rotation methods.
 - If there is no demand for increasing capacity for a certain period, the capacity is forced to increase to rotate the operating order.

There are two methods of initiating the forced rotation by specifying the amount of running hours or time. • Program method

Use this method to combine the various capacities of units and operate them.

This method supports the capacity of eight groups (types). Up to 12 levels can be set as the number of operating units in each group.

This method shifts the operation sequence in the same group as is done in the rotation method.

Note: (1) or (2) in "Rotation method" can be selected.

Table 1. Group table settings

Group		Member unit No.				
1	1	_	_	—		
2	2	3	4	—		
3	—	—	—	—		
4	—	—	—	_		
5	—	—	—	—		
6	—	—	—	—		
7						
8				_		

Note: In Table 1, "Group table settings," one unit with a small capacity is registered in Group 1 and three units with large capacities are registered in Group 2 as an example.

If there is no demand for increasing capacity for a certain period, this method is used for switching the operating units in a group that contains rotatable units.

Note: Units are not rotated if a group does not contain rotatable units.

If multiple groups contain rotatable units, the units in one of them are rotated.

The priority order among groups is also rotated.

				Die Settin	<u> </u>				
Level	Group 1 Number of units	Group 2 Number of units	Group 3 Number of units	Group 4 Number of units	Group 5 Number of units	Group 6 Number of units	Group 7 Number of units	Group 8 Number of units	Load condition of the level
1	1	0	0	0	0	0	0	0	Load ≤ Capacity of the units in Group 1
2	0	1	0	0	0	0	0	0	Capacity of the units in Group 1 < Load ≤ Capacity of the units in Group 2
3	1	1	0	0	0	0	0	0	Capacity of the units in Group 2 < Load ≤ Capacity of the units in Group 1 + Capacity of the units in Group 2
4	0	2	0	0	0	0	0	0	Capacity of the units in Group 1 + Capacity of the units in Group 2 < Load \leq Capacity of the units in Group 2 x 2
5	1	2	0	0	0	0	0	0	Capacity of the units in Group $2 \times 2 < \text{Load} \le$ Capacity of the units in Group $1 + \text{Capacity}$ of the units in Group 2×2
6	0	3	0	0	0	0	0	0	Capacity of the units in Group 1 + Capacity of the units in Group 2 x 2 < Load \leq Capacity of the units in Group 2 x 3
7	1	3	0	0	0	0	0	0	Capacity of the units in Group 2 x 3 < Load
8	_	_	_	_		_	_	_	
9	_	_	_	_		_		_	_
10	—	_	_	_		_		_	—
11	_	—	—	_					—
12	—	—	—	_	—	_	_	—	—

Table 2. Level table settings

(3) Operation sequence table

The operation sequence can be set for each of the following four types of tables:

- · For heating mode and daytime mode
- · For heating mode and nighttime mode
- · For cooling mode and daytime mode
- For cooling mode and nighttime mode

The same operation sequence change method applies to all tables. When the table is changed over, the sequence control at unit startup described later is executed.

In addition, up to eight preset operation sequence table patterns can be automatically changed by separately associating them with I/O objects (up to eight MVs).

(4) Operating sequence adjustment

When the operation table is switched, the operation mode is switched, a unit is restored from a failure or a forced shutdown, etc., you can select one of the following methods for adjusting the operating sequence (only with the sequential method).

• Operating unit priority method

Gives operation priority to running units (ON state) over stopped units (OFF state). This minimizes the counts of start/stop operation.

 Sequence setting priority method Always starts or stops the units according to the operation sequence setting.

When adjusting the operating sequence, the start operation of some units and stop operation of other units may occur simultaneously. If the start and stop operations are executed simultaneously, abnormal pressure rises or drops in unit capacities due to starting delays of units may occur. To prevent this, simultaneous ON/OFF processing will be conducted. The following two processes are available.

• ON priority process

Sequentially starts the units scheduled to start up first, waits for a while to give the units time to start up, and then sequentially stops the units scheduled to shut down.

• OFF priority process

Sequentially stops the units scheduled to shut down first, waits for a while to give the units time to shut down, and then sequentially starts the units scheduled to start up.

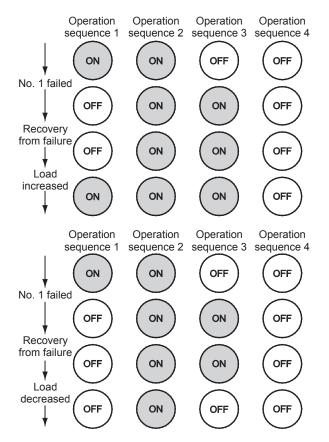


Figure 8. Operating unit precedence method (sequential)

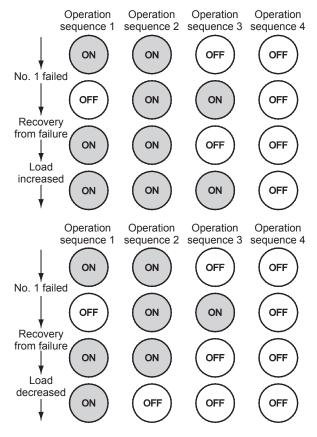


Figure 9. Sequence setting precedence method (sequential)

- (5) Rated capacity setting Define the rated capacity of unit (flow rate) from the central monitoring unit.
- (6) Sequence control at unit startup

When Group command is ON, to shorten the startup time, sequence control by "Start load" will be executed.

Sequence control is forcibly applied when the operation mode is switched from daytime to nighttime so that the units can react to a sudden drop in load during overtime working hours.

When Group command ON is executed or the mode is switched from nighttime to daytime, the actual load will be used if it is greater than the start load. When the mode is switched from daytime to nighttime, actual load will be used if it is smaller than the start load.

The start load can be defined for weekday, multiple special days, daytime mode, and nighttime mode.

Note: When the mode is changed over from daytime to nighttime, the start load (nighttime) or the actual load, whichever is the larger, can be used depending on the setting.

The start load is changed over among weekday and multiple special days using the start load calendar information (MV).

(7) Stabilizing control while waiting for effect

When the number of units is increased or decreased, sequence control is not executed for a certain period of time to wait for the load to stabilize.

- Waiting for effect at startup
 Waiting for effect at startup is defined as the unit's startup time and the water cycle time.
- Waiting for effect at shutdown

Waiting for effect at shutdown is defined as the remaining operating time of the unit that was stopped, the startup time of the units other than the stopped units, and the water cycle time.

(8) Maximum number of operating units

The maximum number of operating units can be set to reserve standby units or to temporarily limit the number of operating units.

While Auto and Group command are ON, the units less than the maximum number of operating units operate.

The maximum number of operating units can be set for the following four patterns.

- For heating mode and daytime mode
- For heating mode and nighttime mode
- For cooling mode and daytime mode
- For cooling mode and nighttime mode
- (9) Minimum number of operating units While Auto and Group command are ON, more units than the minimum number of operating units operate.

(10) Exclusion processing

Sequence control does not apply to units in the following statuses.

However, running units are included when calculating the total rated capacity.

- Stopped by power demand control.
- Stopped by control at power failure.
- Stopped by fire control.
- Stopped or operating by Forced Command (manual override).
- Stopped by shutdown DI input.
- Stopped due to unit failure.
- Stopped or operating due to unmatched state.
- Stopped based on the restart prevention time or the minimum stop time.
- Operation sequence setting "0" (not registered)
- Capacity setting "0"
- Forced stop

Individual units can be shut down (excluded) by inputting the shutdown DI.

Shutdown has priority over all other start commands from the controller that has a pump ON/OFF object the RELIABILITY property of which is not normal.

Note: This can be changed to the shutdown operation from the central monitoring unit by changing the point.

Individual ON/OFF

Individual units can be forced to start or stop from the central monitoring unit.

Individual ON/OFF has priority over all other ON/OFF commands from the Advanced Controller for heat source except for shutdown.

When individual units are forced to start or stop while Auto and Group command are ON, the operation mode is changed to the normal sequence control after the effect wait time, restart prevention time, or minimum stop time elapses.

Note: The individual ON/OFF operation is not available when Auto is selected and Group command is OFF.

Restart prevention control

To protect the units, they will not be restarted during the restart prevention time (a certain amount of time after startup), or the minimum stop time (a certain amount of time after shutdown).

Sequential start/stop control

In order to prevent a rush current and water condensation, simultaneous start or stop of multiple units is prohibited. When multiple units need to be started or stopped, the units will sequentially start up or stop at a constant interval in the registered order, not in the order of the defined operating sequence.

Power demand control

Individual units are stopped by the power demand control command from the central monitoring unit.

At this time, substitute units are not operated to avoid increasing the power consumption. When the power demand control commands for all the units are cleared, the operation mode returns to the normal sequence control.

Control at failure

If a unit fails and stops or ON/OFF fails (the output command and the operating status do not match within a certain amount of time after output), that unit is considered to have failed.

The number of operating units is determined again excluding that unit from the sequence control. If the substitution operation is necessary, substitute units are operated even during the effect wait time.

The stop command is not output for the failed unit.

The following two failure reset methods are available.

Manual reset

Remove the cause of failure of the relevant unit and stop it from the central monitoring unit.

This matches the status to the command and the normal operation is restored.

Auto reset

If the failure auto reset time is set in advance, when the specified time elapses, the Advanced Controller for heat source automatically stops the unit.

This matches the status to the command and normal operation is restored if the failure DI input has been cleared.


Pressure control

(1) Bypass valve/inverter control

One of the following types of control is executed every 0.5 seconds according to the model. The pressure setpoint can be automatically changed depending on the load flow.

• Proportional bypass valve

The bypass valve is controlled by the PID control so that the discharge pressure is constant.




• All inverters + ON/OFF bypass valve

Applies the PID control for the inverter so that the discharge pressure becomes constant.


Each inverter outputs the same valve.

If the load flow falls below the constant value, open the ON/OFF bypass valve to allow minimum flow through the pump.

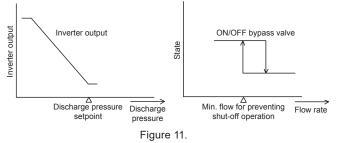

 Inverter (N units) + proportional bypass valve The bypass valve and inverter are controlled by the PID control so that the discharge pressure is constant.
 When two or more pumps operate, a combination of the inverter pumps and constant speed pumps operate.

In this case, set the minimum revolution speed limit values of the inverter for the case where one pump operates and for the case where two or more pumps operate to prevent the flow of the variable speed pumps from stopping.



AS-1002E

• Power failure recovery control

Detection of the power supply status
 A power failure is detected based on the power supply status sent from the central monitoring unit or the power status
 of the target unit DI (OFF = Power supplied, ON = Power failed).

Auto/Manual changeover	Power to the Advanced Controller for heat source failed	Power to the units failed	Power failure time	Operation		
Auto	Yes	Yes	Within a certain amount of time	Sequence control using the actual load before power failure or the start load, whichever is larger. (The units stopped due to the power failure are not restarted.)		
			More than a certain amount of time	Sequence control using the actual load after power recovery or the start load, whichever is larger.		
		No	Within a certain amount of time	Sequence control using the actual load before power failure or the start load, whichever is larger.		
			More than a certain amount of time	Sequence control using the actual load after power recovery or the start load, whichever is larger.		
	No	Yes	_	Sequence control using the larger one of the actual load or start load. (The units stopped due to the power failure are not restarted.)		
Manual	Yes	Yes		Stops all units.		
		No		The same status as before power failure		
	No	Yes		Stops all units.		

(2) Operation at power recovery

Notes:

 It is assumed that the units use commercial power or a combination of commercial power and generators. Under normal circumstances, it is not possible for only the power to the Advanced Controller for pump units to fail. The above description assumes the case where the control panel is turned off for maintenance or other purposes.

 "Power to the units failed" means that the power to all the units have failed. For the operation when units are turned off without setting Manual for maintenance or other purposes, see the above description about control at failure.

3. Stop of units due to power failure is different from stop by sequence control. Stabilizing control while waiting for effect is not executed after a stop due to power failure.

4. The case where the mode is changed over between Auto and Manual before and after power failure is not described here.

5. The amount of time is defined using the parameter (Default: 120 seconds).

Indicators

Product status LEDs

POWER	
RUN	
NST	
ERROR	
BATT	
	/

Item	LED name	Color	State	Description
Power supply status	POWER	Green	Lit	Power ON
			Not lit	Power OFF
Operation mode	RUN	Green	Lit	Operating in RUN mode
			High speed blinking (0.2 sec cycle)	ETHERNET congestion detected
			Low speed blinking (1.4 sec cycle)	Operating in DEBUG mode
			Not lit	Operating in IDLE mode
Network status	NST	Orange	Lit	Non-ring is set for communication with the local I/O network.
			High speed blinking (0.2 sec cycle)	If Ring is set, the ring for communication with the local I/O network is disconnected at some node.
			Low speed blinking (1.4 sec cycle)	If Ring is set, the ring for communication with the local I/O network is disconnected between adjacent nodes.
			Not lit	If Ring is set, the ring for communication with the local I/O network is connected normally.
Abnormal status	ERROR	Red	Lit	Major failure
			Flashing	Minor failure
			Not lit	Normal
Battery status	BATT	Red	Lit	Battery voltage low
			Not lit	Normal battery voltage


AS-1002E

• Communication status LEDs

1	00 100)0 RX	ХТ Х	EOL	
LAN 0	0 0	485-1 O	0	0	
LAN	0	485-2 O	0	0	
LAN 2					

Item	LED name		Color	State	Description	
Communication status	LAN0 100		Green	Lit	A link is established at 100 Mbps.	
				Flashing	Data is being transmitted and received at 100 Mbp	
				Not lit	A link is not established at 100 Mbps.	
	LAN0 1000		Green	Lit	A link is established at 1 Gbps.	
				Flashing	Data is being transmitted and received at 1 Gbps.	
				Not lit	A link is not established at 1 Gbps.	
Communication status	LAN1		Green	Lit	A link is established.	
				Flashing	Data is being transmitted and received.	
				Not lit	A link is not established.	
	LAN2		Green	Lit	A link is established.	
				Flashing	Data is being transmitted and received.	
				Not lit	A link is not established.	
RS-485 CH1	485-1	RX	Green	Flashing	Data is being received.	
Communication status				Not lit	Data is not being received.	
		ТХ	Green	Flashing	Data is being transmitted.	
				Not lit	Data is not being transmitted.	
		EOL	Green	Lit	RS-485 built-in terminating resistor ON	
				Not lit	RS-485 built-in terminating resistor OFF	
RS-485 CH2	485-2 RX		Green	Flashing	Data is being received.	
Communication status	-			Not lit	Data is not being received.	
		TX G	Green	Flashing	Data is being transmitted.	
				Not lit	Data is not being transmitted.	
		EOL	Green	Lit	RS-485 built-in terminating resistor ON	
				Not lit	RS-485 built-in terminating resistor OFF	

IO status LEDs

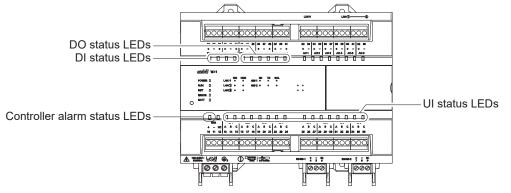

Item	LED name	Color	State	Description
DI status	DI1–DI4	Green	Lit	DI ON
			Not lit	DI OFF
DO status	DO1-DO6	Green	Lit	DO ON
			Not lit	DO OFF
UI status	UI1–UI8	Green	Lit	DI is ON when DI is set.
			Not lit	DI is OFF when DI is set.

• Controller alarm status LED

Item	LED name	Color	State	Description			
Controller alarm	ERR	Green	Lit	Controller alarm output enabled	In RUN mode:	lit	
status				(control output is enabled)	Other than RUN mode:	not lit	
			Not lit	Controller alarm output disabled	Major failure occurred:	not lit	
				(control output is disabled	Powered OFF:	not lit	

AS-1002E

This blank page was added for page layout purposes.

This blank page was added for page layout purposes.

For CE-Marked Products

Install this product in a panel cabinet. Additionally, always keep the panel cabinet accessible only to people with sufficient knowledge concerning electrical equipment.

This product complies with the following harmonised standards of the Radio Equipment Directive (RED), the Electromagnetic Compatibility Directive (EMCD), and the Low Voltage Directive (LVD).

RED : EN 300 330

- EMCD : EN 61326-1 Class A, Table 2 (for use in an industrial electromagnetic environment) EN 301 489-1 / EN 301 489-3
- LVD : EN 61010-1 Overvoltage category II
 - Pollution degree 2

For UL-Marked Products

Install this product in a panel cabinet.

•E492866 •UL 60730-1

•PAZX ENERGY MANAGEMENT EQUIPMENT



- •Pollution degree 2
- •Overvoltage category II •Rated impulse voltage 4000V
- •IP20
- •TYPE 1 ACTION

The model numbers of the UL-certified product are WJ-1102P_____U and WJ-1102W0000-U. WJ-1102P_____U is listed by UL as WJ-1102W0000-U.

For BTL-Listed Products



Firmware version 1.3.22 and later of this product comply with BTL certification requirements.

ACTIVAL is a trademark of Azbil Corporation. BACnet is a registered trademark of ASHRAE. Modbus is a trademark and the property of Schneider Electric SE, its subsidiaries and affiliated companies.

Azbil Corporation

Building Systems Company



AS-1002E Rev. 6.0 Oct. 2022

(J: AS-1002 Rev.6.0)

https://www.azbil.com/